

- For control of heating or cooling in zone control systems
- 0...10 VDC, 1 mA or 3-point 24VAC, 1A
- Setpoint 0...40 °C
- P or PI mode selection
- Occupancy mode control
- Change-over function
- External sensor TG-K340B (Optional)
- Auto change-over sensor TG-A130B (Optional)




Technical data

Electrical data	Nominal voltage	AC 24V 50/60 Hz
	Power supply range	AC 19.2 ... 28.8V
	Power consumption	2VA
Functional data	Input	
	External sensor	Type NTC, 10kOhm@40°C, TG-K340B [Optional]
	Change-over	Potential-free relay contact or NTC-sensor, TG-A130B (0...30°C) [Optional]
	Occupancy	Potential-free contact
	Output	
	Control signal	0...10 V DC, 1 mA or 3-point AC 24V, 1A
Working conditions	Settings	
	Setpoint	0...40°C (Base setpoint value is 22°C)
	P-band	0.5...50 K
	Reset-time(I-time)	2 or 20 min, see jumper setting below
	TrimPot(Occupancy)	+/-6°C
	Degree of protection	IP20
	CE	CENELEC EN 61000-1 and EN 61000-3
	Ambient conditions	0 ... +50°C
	Non-operating temperature	-10 ... +60°C
	Ambient humidity range	max. 90% r.h. , non-condensing
Dimensions	Dimensions (L x H x D)	86 x 86 x 30 (mm)

Function selection (jumpers)

Fig.1

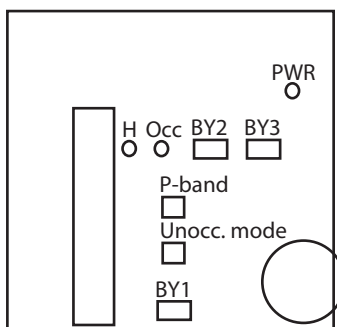

- Jumper BY1 Right = Internal sensor (**factory setting**)
- Left = External sensor
- Jumper BY2 Closed = Reset time (I-time) is 2 min
- Open = Reset time (I-time) is 20 min (**factory setting**)
- BY2 setting valid only when jumper BY3 is set to PI-function
- Jumper BY3 Closed = P-function
- Open = PI-function (**factory setting**)
- To obtain open position place the jumper on one pin only.


Product function

Sensor The controller has a built-in temperature sensor element. External sensor TG-K340B can be connected. See function selection for jumper setting.
For auto change-over function, sensor TG-A130B should be used.

Occupied/Unoccupied mode The setpoint can be adjusted in accordance to an input for occupancy. On open contact, the thermostat setpoint is determined by the setpoint adjuster (occupied mode). On closed contact, the setpoint is determined by an internal trimpot (unoccupied mode). The base setpoint value is 22 °C.. It can be reset depending on the setting of the potentiometer "Unoccupied", and is adjustable with a span of +/-6°C. **[Factory setting = 3 (25°C, 19°C)]**

Position	0	1	2	3	4	5	6
Cooling setpoint	22	23	24	25	26	27	28 °C
Heating setpoint	22	21	20	19	18	17	16 °C


Change-over An input can be connected to a NTC-sensor (TG-A130B) or a closing relay contact. On closed contact the controller works with heating output and on open contact cooling. When using sensor for auto change-over, the temperature range must be 0...30°C and sensor should be mounted on the surface of pipe in order to give accurate temperature values. When the temperature at the sensor exceeds 22 °C, the output function is switched to heating and when the temperature falls below 18 °C the output is set to cooling.

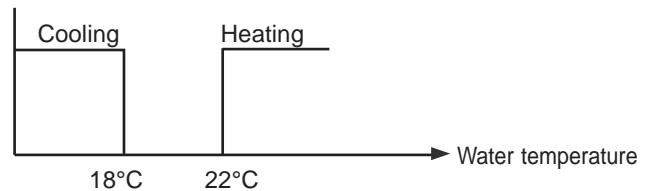


Indications Green LED (PWR) : for activated output (see Fig. 1)
Red LED (H) : lit for heating, not lit for cooling
Green LED (Occ) : lit for occupied mode, not lit for unoccupied mode.

Setpoint Adjust with knob that extends from the lower right of the casing. The knob setting can be mechanically fixed with a latchscrew located under the front cover.

Setpoint calibration The knob rim with the scale can be detached from the hub and remounted in new position. Grip across the rim and pull out at the same time as maintaining an inward pressure on the hub. When re-mounting, make sure the parts snap together properly.



Dimensions[mm] & Terminals

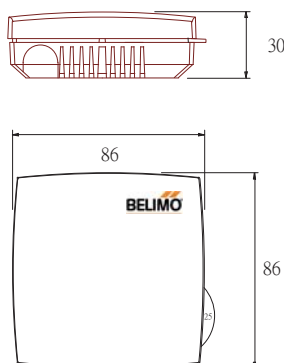

1	AC 24V supply
2	System neutral
3	3-point output - neutral
4	3-point output - open
5	3-point output - close
6	0...10V DC control output
7	Signal neutral
8	Change-over input
9	Occupancy input
10	External sensor

Terminals	7 & 8	7 & 9	7 & 10
Function	Change-over	Occupancy	External sensor

Terminals 7 & 8	Short	Open	Sensor
Function	Heat	Cool	Automatic control